

TEMPERATURE/MATURITY TEST

Report Prepared at July 22,2016 10:21 AM

DESCRIPTION


Project Name:	Demo
Section Name:	Floor1
Sensor Name:	C-5
Location:	301 Moodie Dr.
Tagged By:	Chris
Pouring Time:	April 27,2016 8:11 AM
Concrete Mix:	Demo mix 1
Method:	Method1 a= -22.27 b= 10.47
Comments:	sensor located close to HVAC duct opening




TEST RESULTS

Max Temperature:	27 °C
Min Temperature:	7 °C
Maturity Index:	5333.0 °C-hrs
Strength:	16.8 MPa


TEMPERATURE

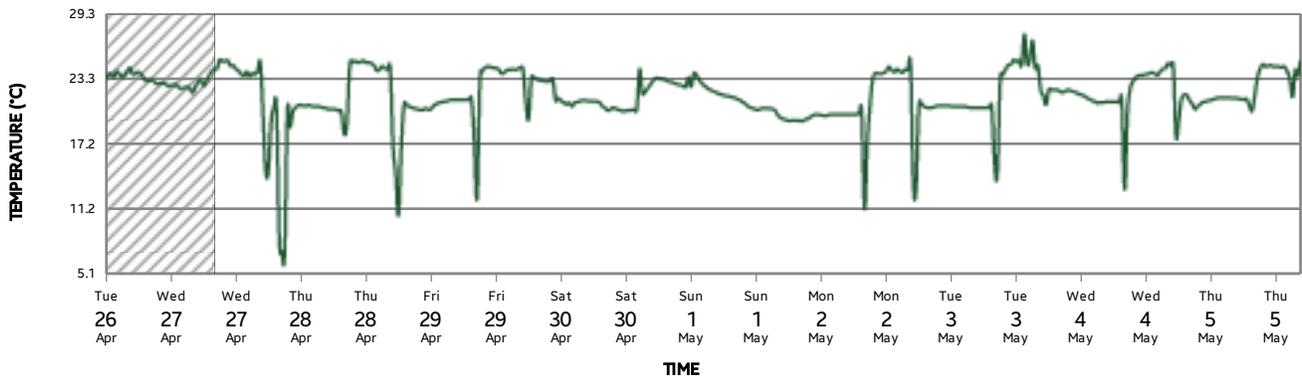

MATURITY

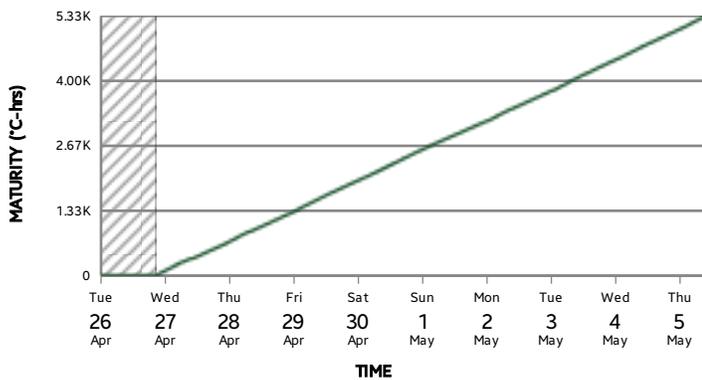

STRENGTH

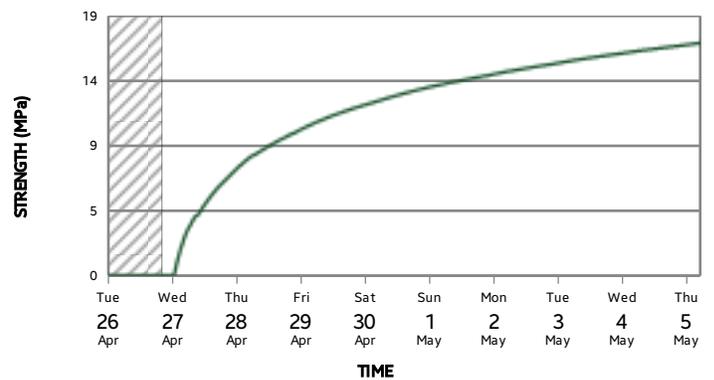

signature